



REV.	DATE	PURPOSE	SKN.

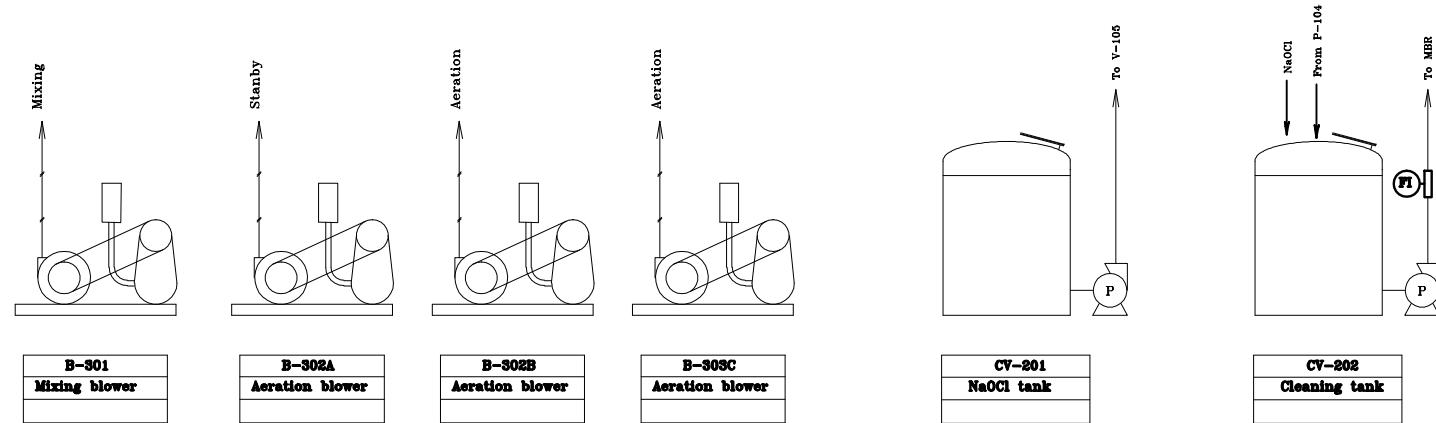

TCVN-5945-2005-CLASS A

	GUARANTEE
Q	3,000 m ³ /day
pH	6.0-9.0
BOD	< 30 mg/l
CODcr	< 50 mg/l
SS	< 50 mg/l
TP	< 4 mg/l
TN	< 15 mg/l

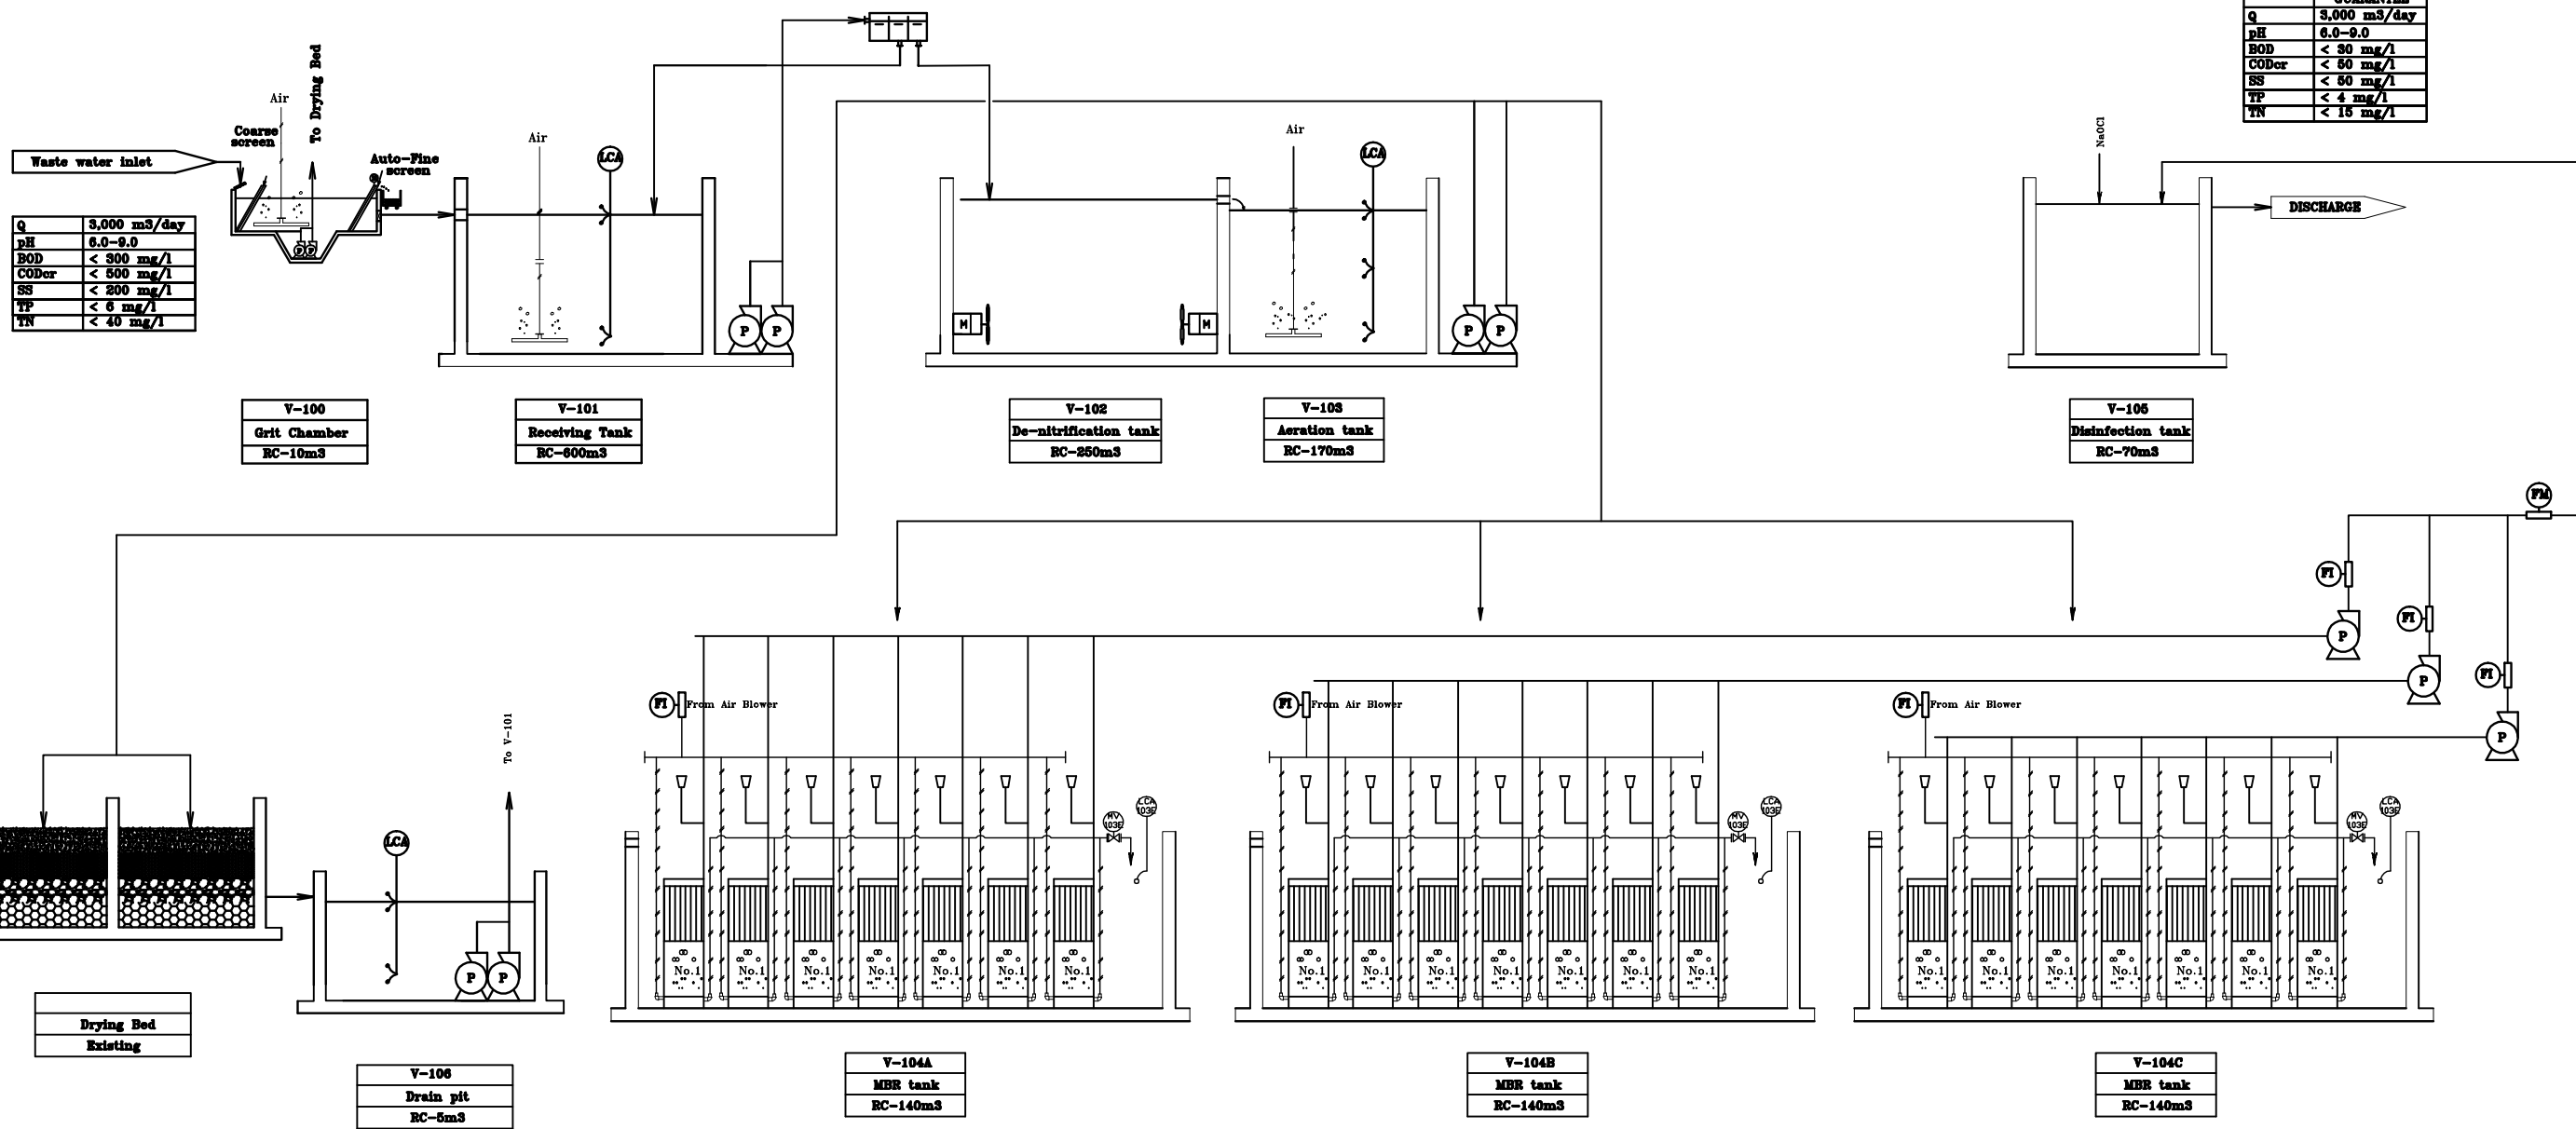

CONTENTS	FUJIKASUI ENERGY AND ENVIRONMENT TECHNOLOGY CO.,LTD	PLANT : WASTE WATER TREATMENT PLANT PHASE III COMPANY : THANG LONG INDUSTRIAL PARK	SCALE	DESIGNED BY	DRAWN BY	CHECKED BY	CHECKED BY	APPROVED BY	DRAWING TITLE	FLOW CHART	REV. NO.
				P.N.D.K	P.N.D.K	N.D.K		C.Y.D			
											MICRO FILM NO. FILE NO.